


**WATER & SEWER
COMMISSION**

METER AND BACKFLOW SCHEMATIC FOR DOMESTIC IRRIGATION SERVICES

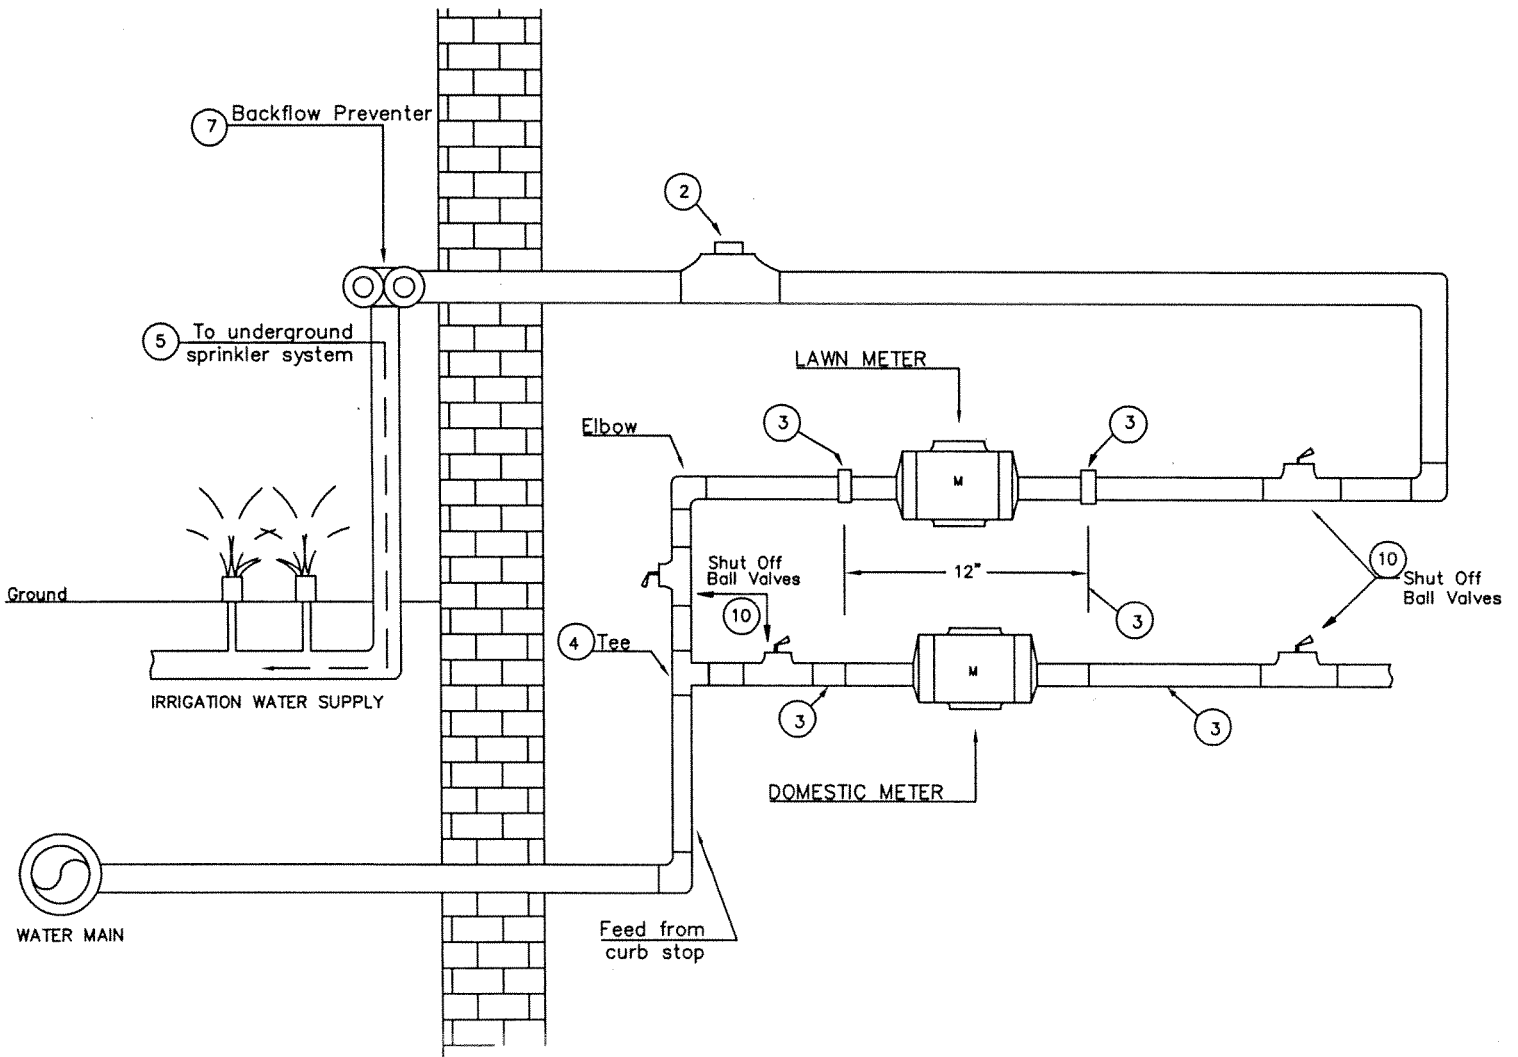

Notes:

- 1) No spigots or draw offs allowed on irrigation meter system.
- 2) Blow off connection must be plugged.
- 3) Allow 3/4" Female threaded pipe (12" spread) for meter installation.
- 4) Feed for irrigation meter must be cut in prior to domestic meter.
- 5) Underground sprinkler system must be fully installed in yard and connected to Backflow Preventer prior to installation of lawn meter.
- 6) Irrigation meter installation must be inspected by City of Lynn Plumbing Inspector.
- 7) Backflow Preventer must be installed minimum 12" above ground level.
- 8) Outside Backflow Preventer can be single check valve type.
- 9) Inside or underground Backflow Preventer MUST be double check valve type.
- 10) Shut off ball valves must be installed upstream and downstream of irrigation meter.